

PARLETT-SOUTH CADIZ

TRANSMISSION LINE REBUILD PROJECT



An AEP Company

BOUNDLESS ENERGY™

AEP Ohio representatives plan power grid upgrades to improve electric reliability for customers in Harrison County. The Parlett-South Cadiz Transmission Line Rebuild Project involves updating about 10 miles of power line.



WHAT

The project involves rebuilding about 10 miles of power line.

WHY

The improvements:


- Strengthen the local electric transmission system
- Reduce the likelihood of power outages
- Speed recovery of service when outages occur

WHERE

The project area includes Cadiz, Green and Short Creek townships in Harrison County



PROJECT SCHEDULE

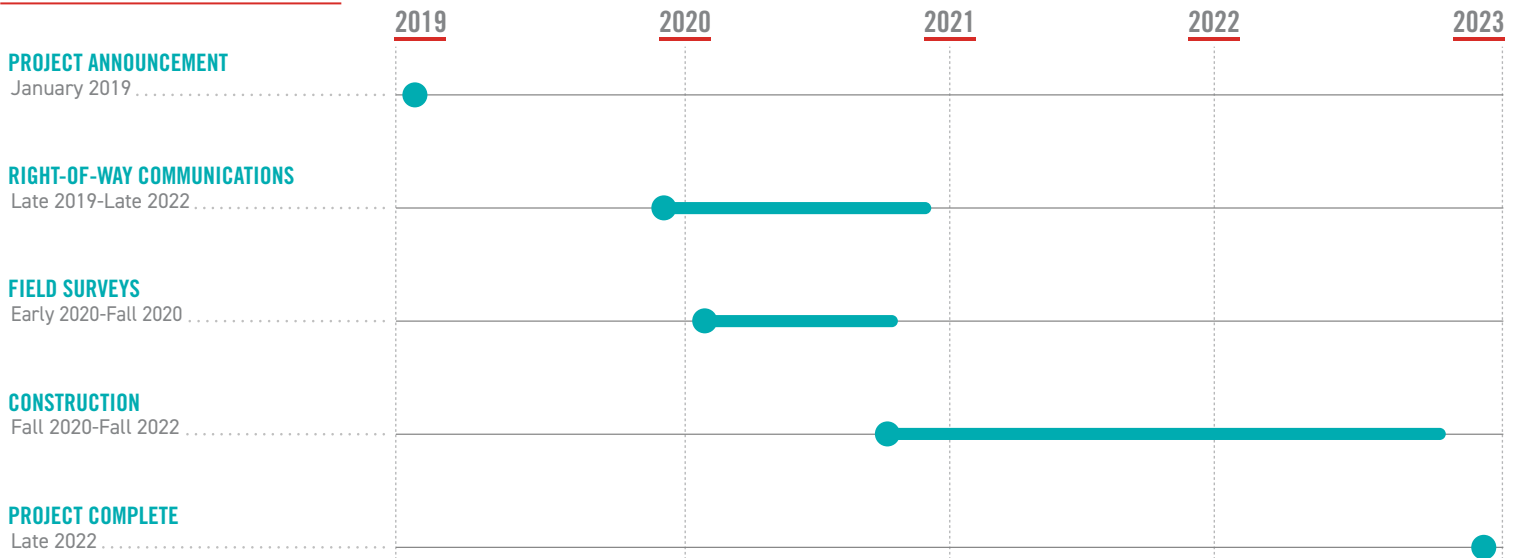


*Timeline subject to change.

PARLETT-SOUTH CADIZ TRANSMISSION LINE REBUILD PROJECT

- EXISTING TRANSMISSION LINE
- TRANSMISSION LINE TO BE REBUILT

EXISTING SUBSTATION

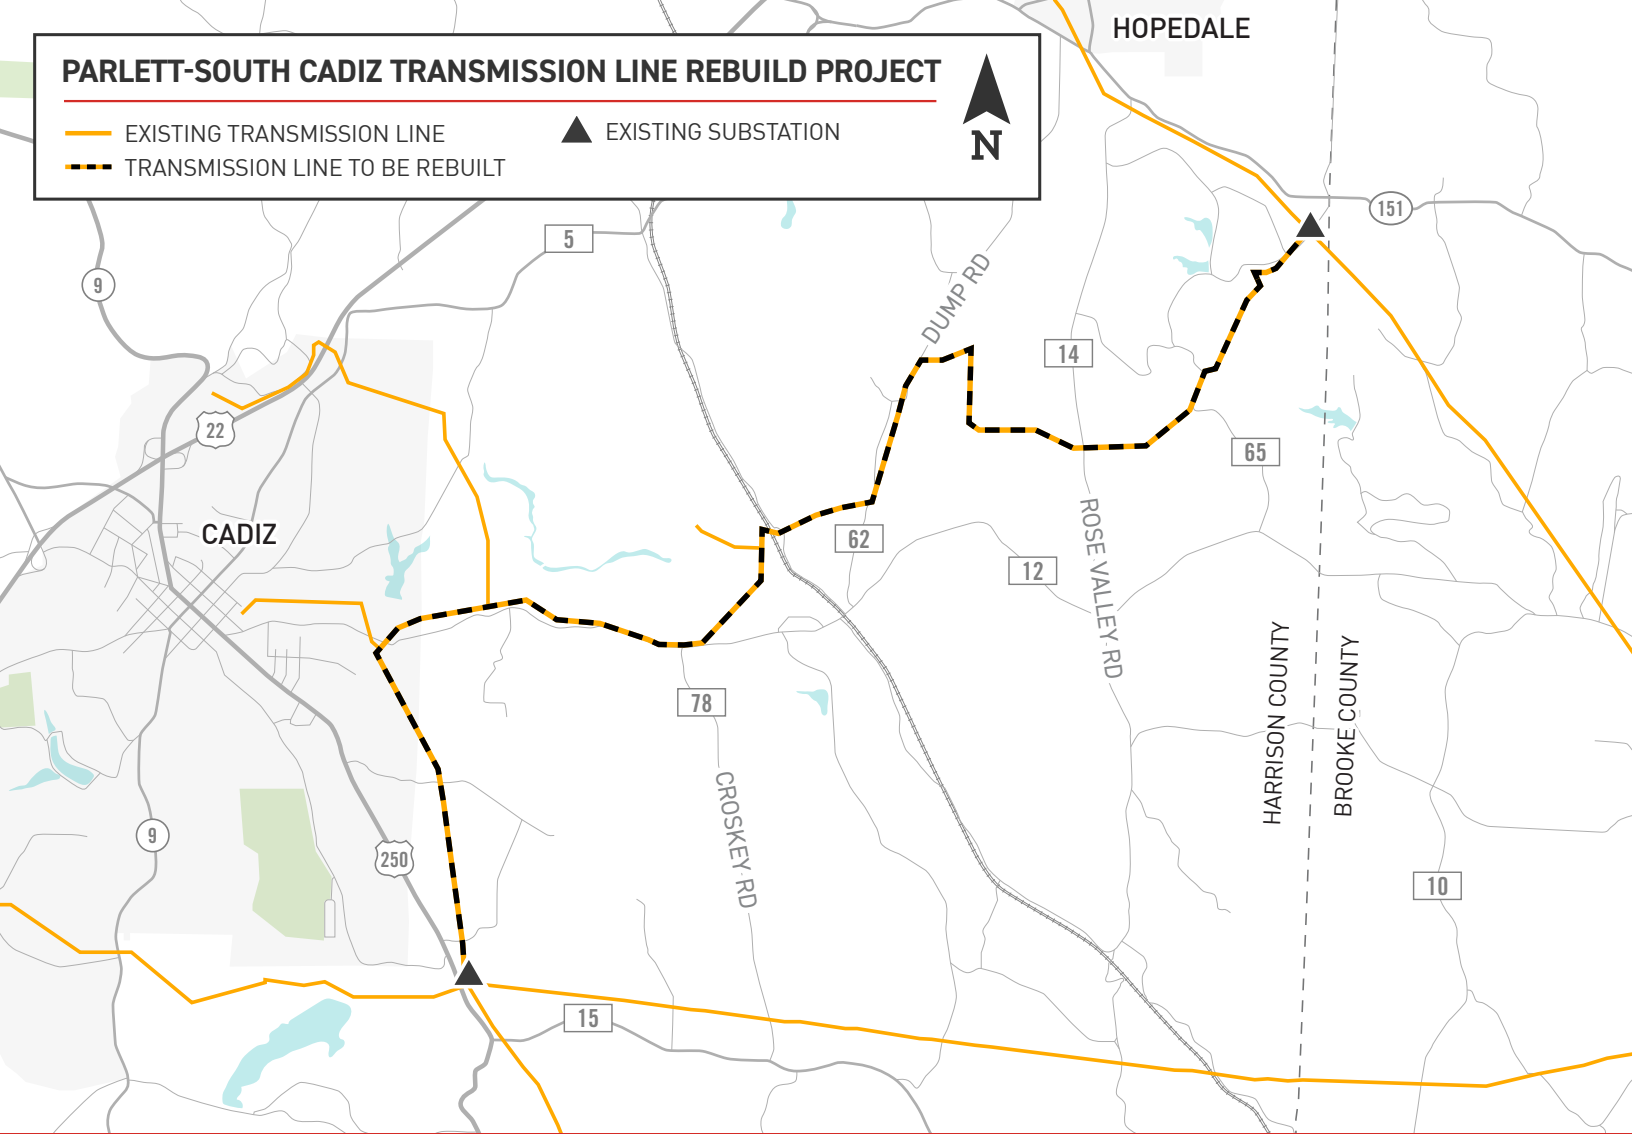

TYPICAL STRUCTURES

Structure Height: Approximately 80-90 feet*
Right-of-Way Width: Approximately 60 feet*

*Exact structure, height and right-of-way requirements may vary



AEP OHIO VALUES YOUR INPUT ABOUT THIS PROJECT. PLEASE SEND COMMENTS AND QUESTIONS TO:

 AEP Ohio
c/o Joseph Demaree
8600 Smiths Mill Rd
New Albany OH 43054

 jkdemaree@aep.com
 (380) 205-5046
 AEPOhio.com/Parlett-SouthCadiz

