

NOTICE OF PROPOSED MAJOR UTILITY FACILITY

AEP Ohio representatives plan an electric transmission project to provide power to a customer.

AEP Ohio representatives plan to rebuild and reroute three existing 138-kilovolt (kV) transmission lines to serve the new Arboles Substation, located off Perimeter Road, south of Piketon, Pike County. The transmission lines are part of the recently filed Arboles 138 kV Station Project, Case No. 21-1084-EL-BLN, and is necessary to provide service to a customer and allow crews to retire an existing substation.

AEP Ohio representatives have filed a Letter of Notification for the transmission line adjustments with the Ohio Power Siting Board (OPSB) as the Arboles Station 138 kV Transmission Line Adjustment Project, Case No. 22-0447-EL-BLN. The Letter of Notification to construct, operate and maintain this facility awaits OPSB review.

The OPSB accepts motions to intervene in the Letter of Notification up to 10 days following the publication date of this notice. The requirements to intervene are included in Rule 4906-2-12 of the Ohio Administrative Code. Please address motions to Ohio Power Siting Board, 180 E. Broad St., Columbus, Ohio, 43215-3793 and cite Case No. 22-0447-EL-BLN.

The accompanying map shows the project area. Please use this map only as a general guide due to its reduced scale and limited detail. Copies of the Letter of Notification, including specific details about the location and construction, are available for public inspection at the following locations:

Garnet A. Wilson Public Library – Main Library, 207 N. Market St., Waverly, Ohio, 45690

Garnet A. Wilson Public Library – Piketon Branch, 200 E. Second St., Piketon, Ohio, 45661

Ohio Power Siting Board, 180 E. Broad St., Columbus, Ohio, 43215-3793, (866) 270-6772, contactopsb@puc.state.oh.us

Electronic versions of the Letter of Notification are available at AEPTransmission.com and at the OPSB website at <http://opsb.ohio.gov>. Search under current cases for Case No. 22-0447-EL-BLN.

The following local city and county government officials have been served with a copy of the application as required by OPSB regulations:

Pike County Commissioner, Mr. Jeff Chattin

Pike County Commissioner, Mr. Tony Montgomery

Pike County Soil & Water Conservation District, Ms. Darlene Brewster

Scioto Township Trustee, Mr. Bernard Neal

Scioto Township Fiscal Officer, Jaime Steffy

Pike County Commissioner, Mr. Jerry Miller

Pike County Engineer, Mr. Denny Salisbury

Scioto Township Trustee, Mr. Michael Cuckler

Scioto Township Trustee, Mr. Lewie Pritchett


If you are a local city or county government official and would like an electronic or hard copy of the Letter of Notification, please contact Brian Recker at the information listed below.

To ask a question or make a comment about the project, please call (380) 205-5381 or send an email inquiry to brecker@aep.com.

Send mail inquiries to the following address:

AEP Ohio

Attention: Brian Recker
8500 Smiths Mill Rd.
New Albany, OH 43054

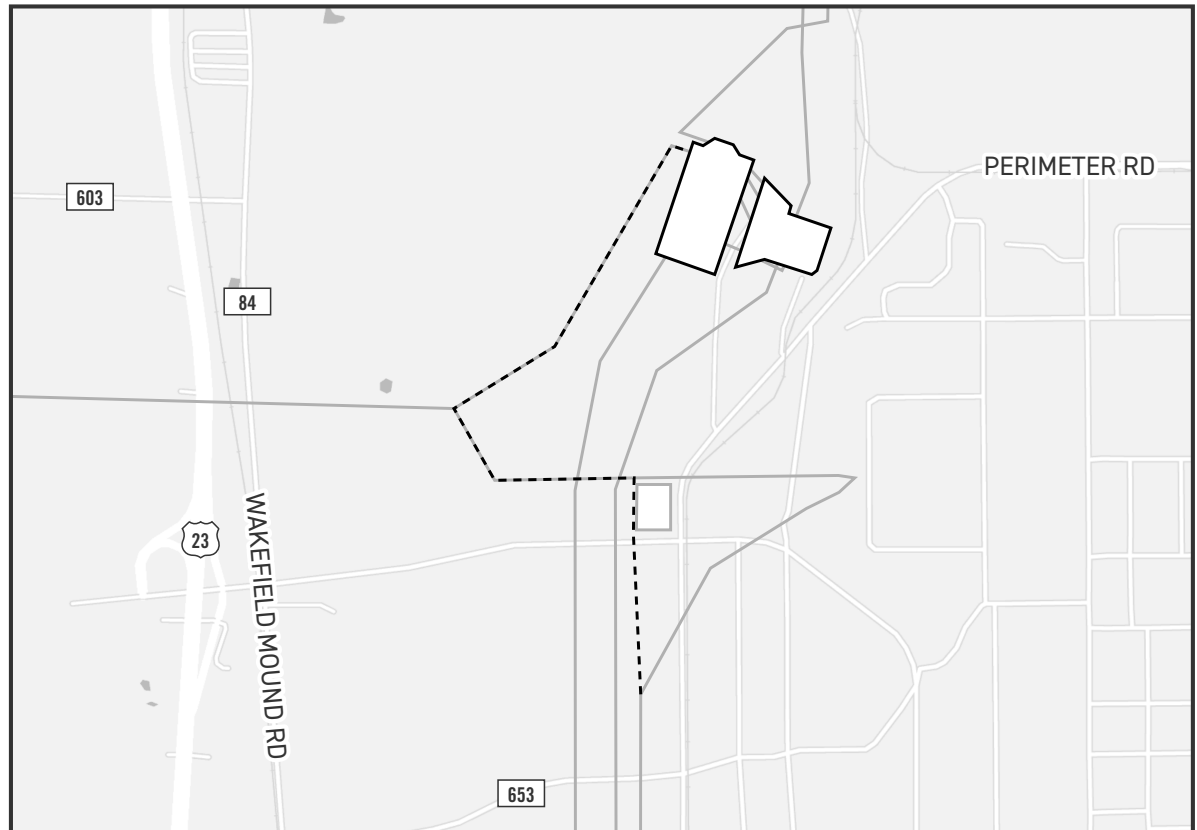

ARBOLES STATION 138 KV TRANSMISSION LINE ADJUSTMENT PROJECT

--- PROPOSED TRANSMISSION LINE ADJUSTMENT
— EXISTING TRANSMISSION LINE

□ PROPOSED ARBOLES SUBSTATION
□ EXISTING SUBSTATION



An AEP Company

BOUNDLESS ENERGY™