

PARLETT-SOUTH CADIZ

TRANSMISSION LINE REBUILD PROJECT



AEP Ohio representatives plan power grid upgrades to improve electric reliability for customers in Harrison County. The Parlett-South Cadiz Transmission Line Rebuild Project involves updating about 10 miles of power line.



WHAT

The project involves rebuilding about 10 miles of power line.

WHY

The improvements:


- Strengthen the local electric transmission system
- Reduce the likelihood of power outages
- Speed recovery of service when outages occur

WHERE

The project area includes Cadiz, Green and Short Creek townships in Harrison County



PROJECT SCHEDULE

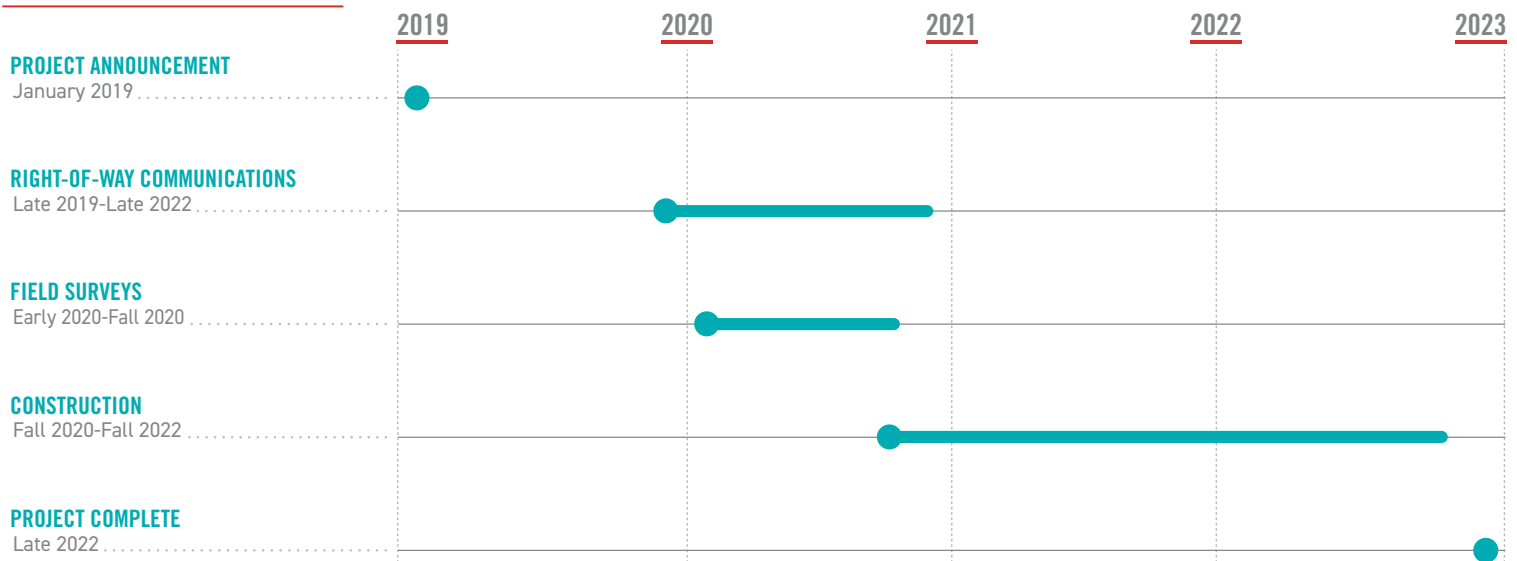


*Timeline subject to change.

PARLETT-SOUTH CADIZ TRANSMISSION LINE REBUILD PROJECT

— EXISTING TRANSMISSION LINE

- - - TRANSMISSION LINE TO BE REBUILT

▲ EXISTING SUBSTATION

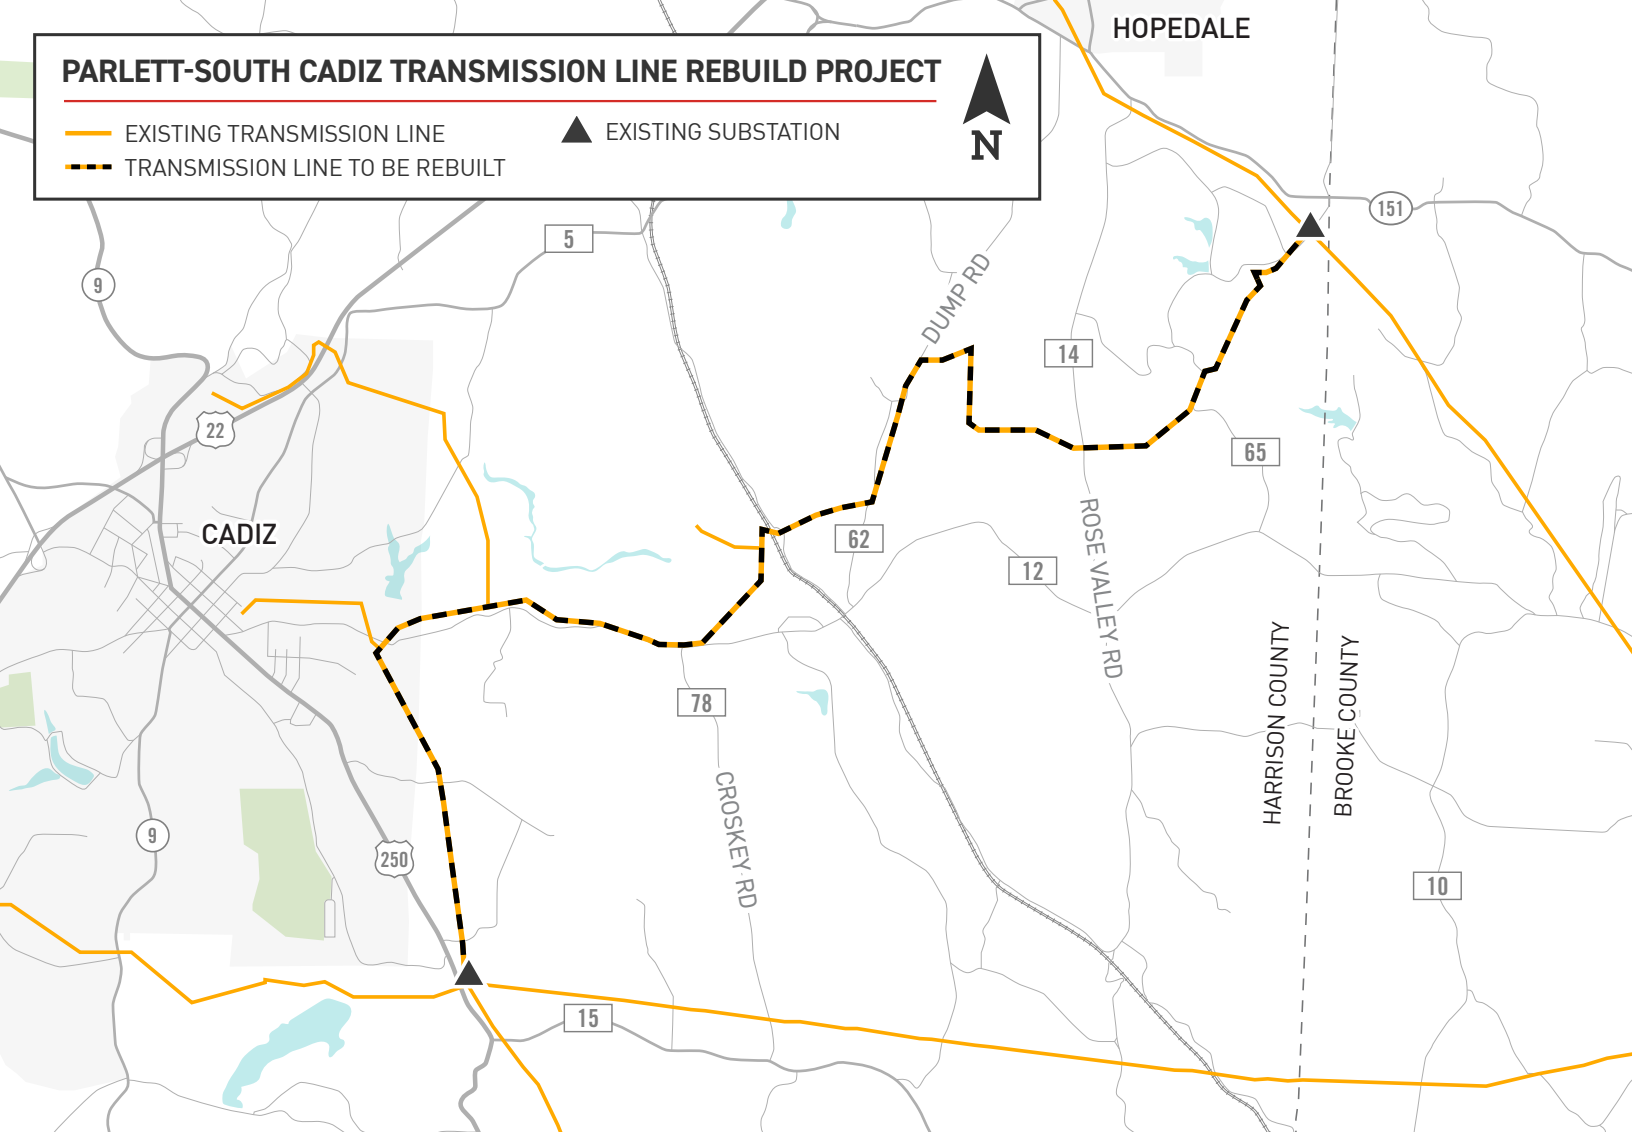

TYPICAL STRUCTURES

Structure Height: Approximately 80-90 feet*

Right-of-Way Width: Approximately 60 feet*

*Exact structure, height and right-of-way requirements may vary



AEP OHIO VALUES YOUR INPUT ABOUT THIS PROJECT. PLEASE SEND COMMENTS AND QUESTIONS TO:



AEP Ohio
c/o AEP Ohio Outreach Team
8500 Smiths Mill Road
New Albany, OH 43054



AEPOhio_Outreach@aep.com



614-933-2998



AEPOhio.com/Parlett-SouthCadiz

