


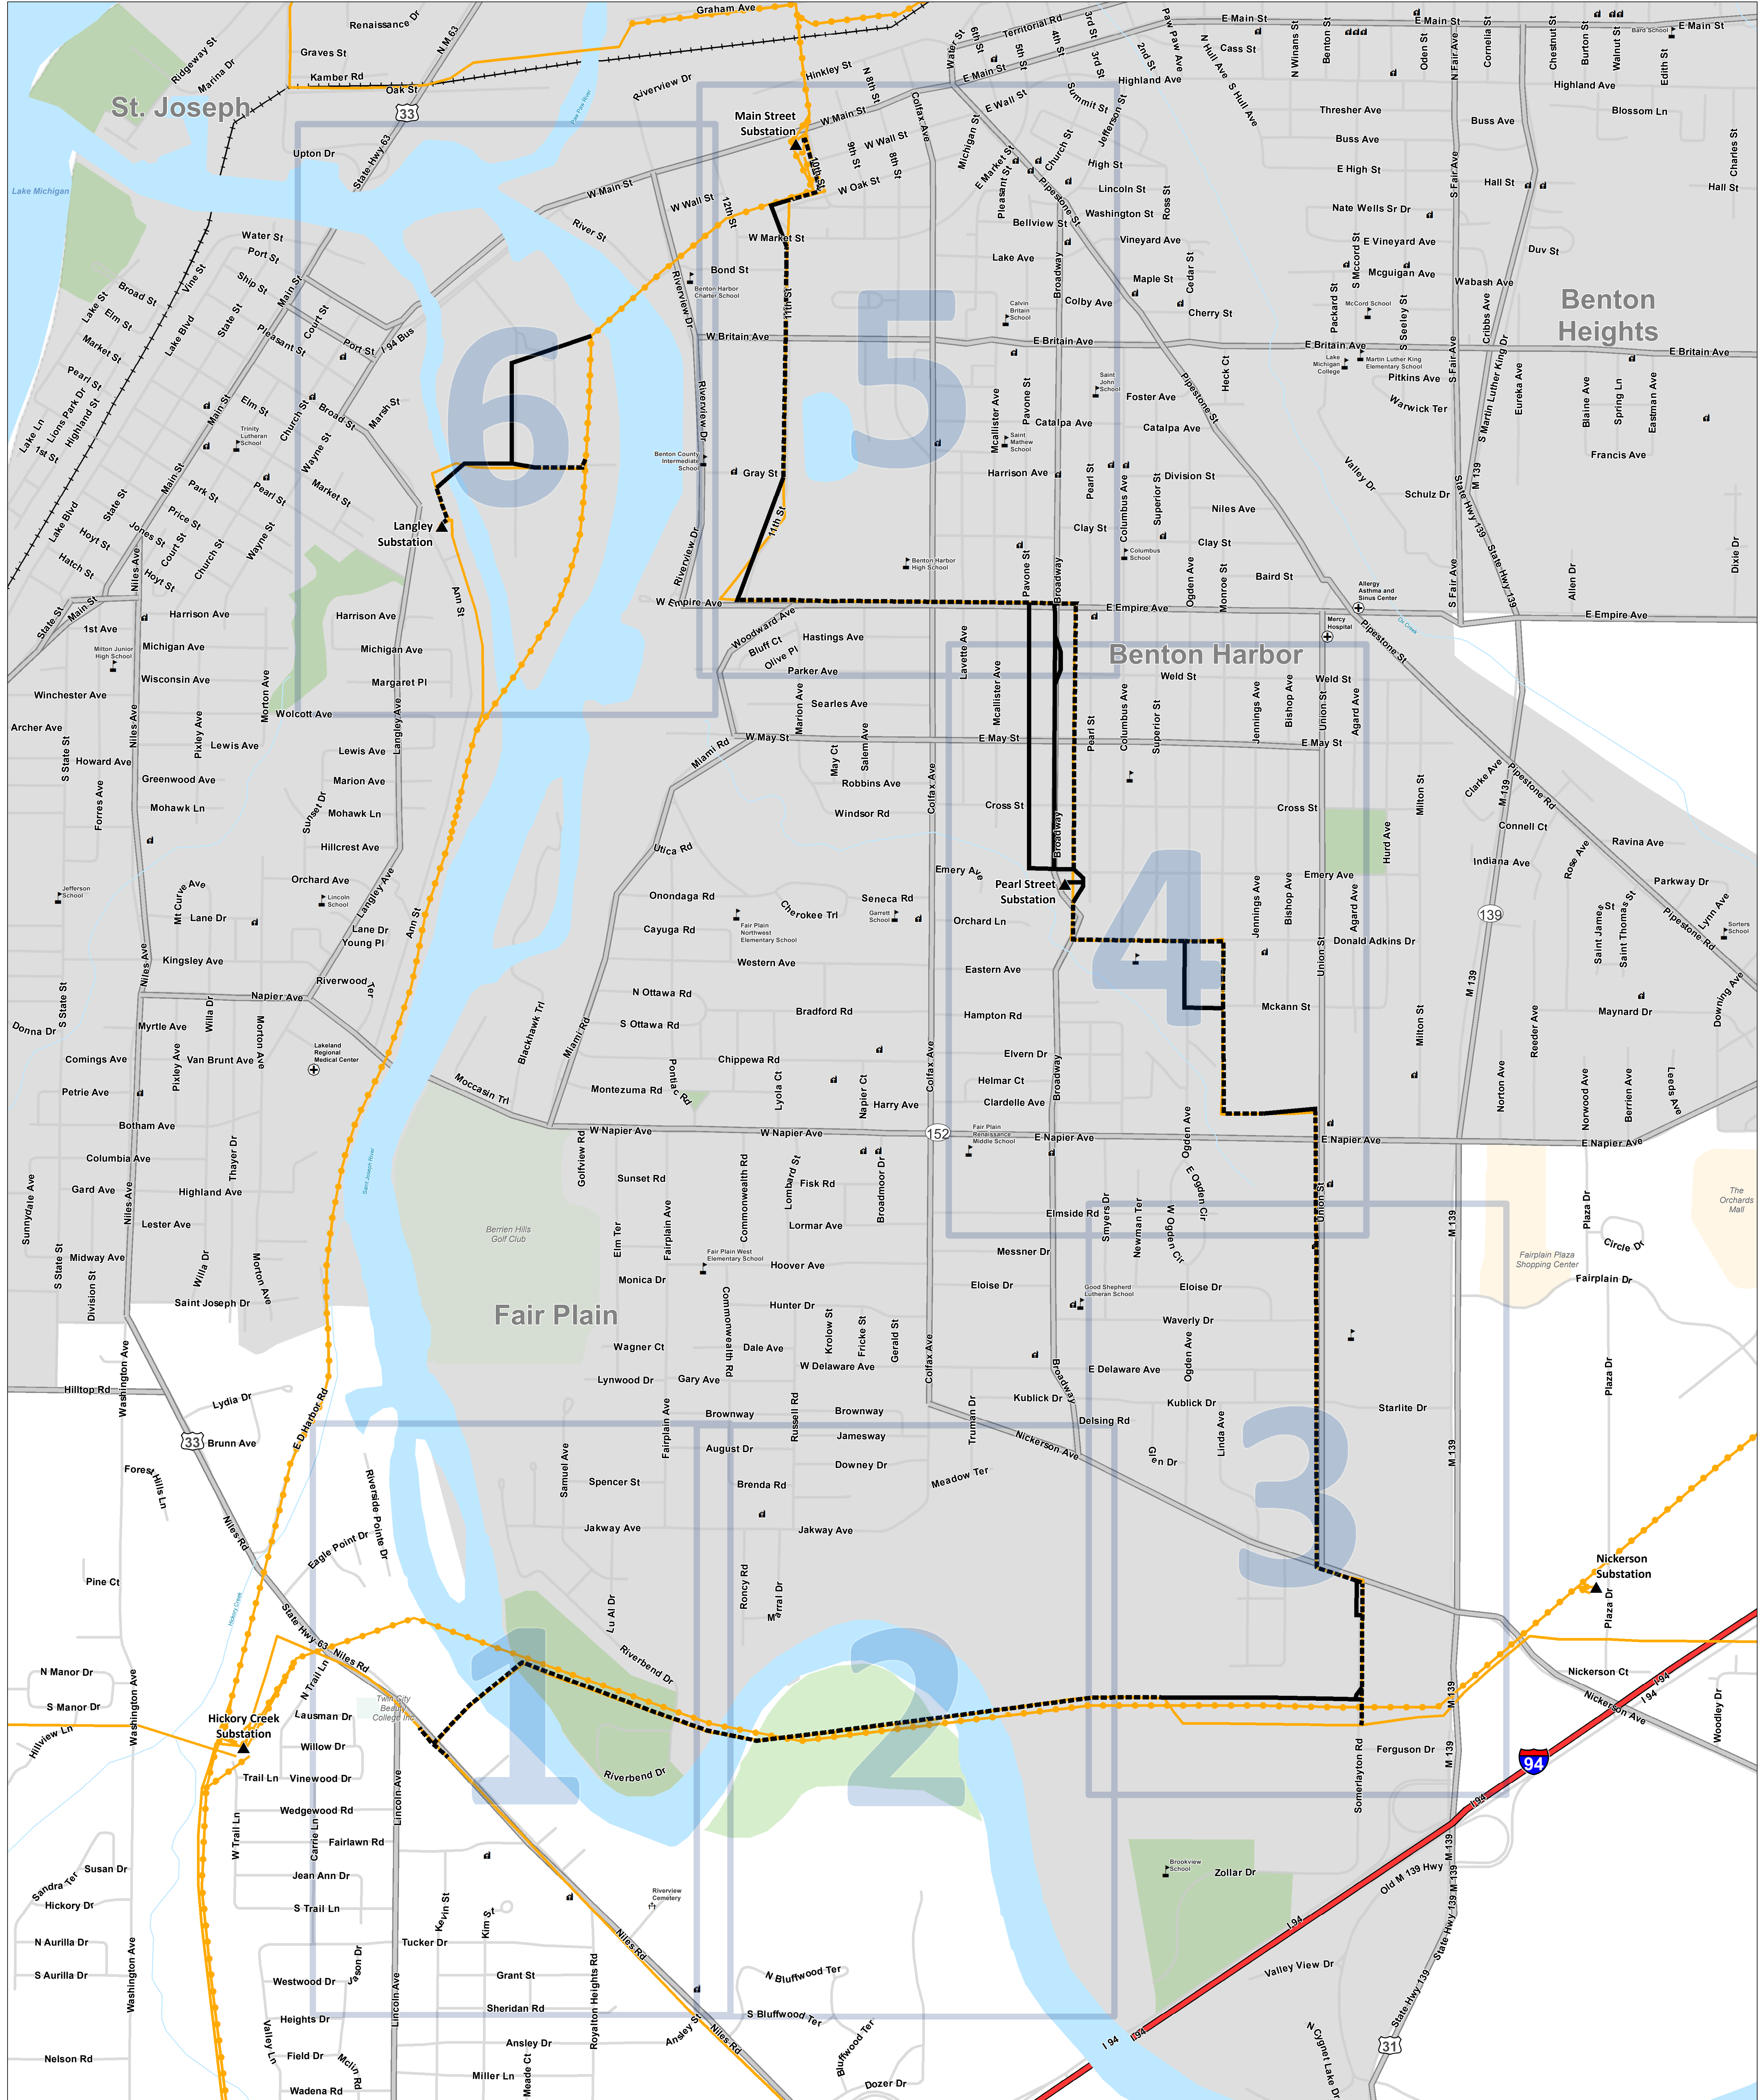

▲ Existing Substation (AEP)

— Study Segment

--- Existing Alignment to be Rebuilt

— Existing Transmission (69 kV or lower)

— Existing Transmission (138 kV - 230 kV)

□ Figure Key

■ Park

+++ Railroad

INDIANA

MICHIGAN

POWER

An AEP Company

BOUNDLESS ENERGY™

Transmission line routes are preliminary and subject to change

1 inch = 500 feet

When printed at 35x48

0 500 1,000 1,500 2,000

0 0.25 0.5

Feet Miles

↑

N

December 21, 2020

Index Overview Map

Benton Harbor to Fair Plain
Transmission Line Rebuild Project